


NOTES

1. See Contract for size and location of all pipes and orifices.
2. Baffle wall shall have #4 Bar at 12" spacing each way.
3. Precast baffle shall be keyed and grouted in place.
4. Bottom orifice plate shall be galvanized steel with a minimum thickness of $\frac{1}{4}$ ". Attach orifice with $\frac{1}{2}$ " stainless steel bolts. Orifice plate is not required when only oil separation is desired.
5. Upper flow orifice shall be aluminum, aluminized steel or galvanized steel. Galvanized steel shall have treatment 1.

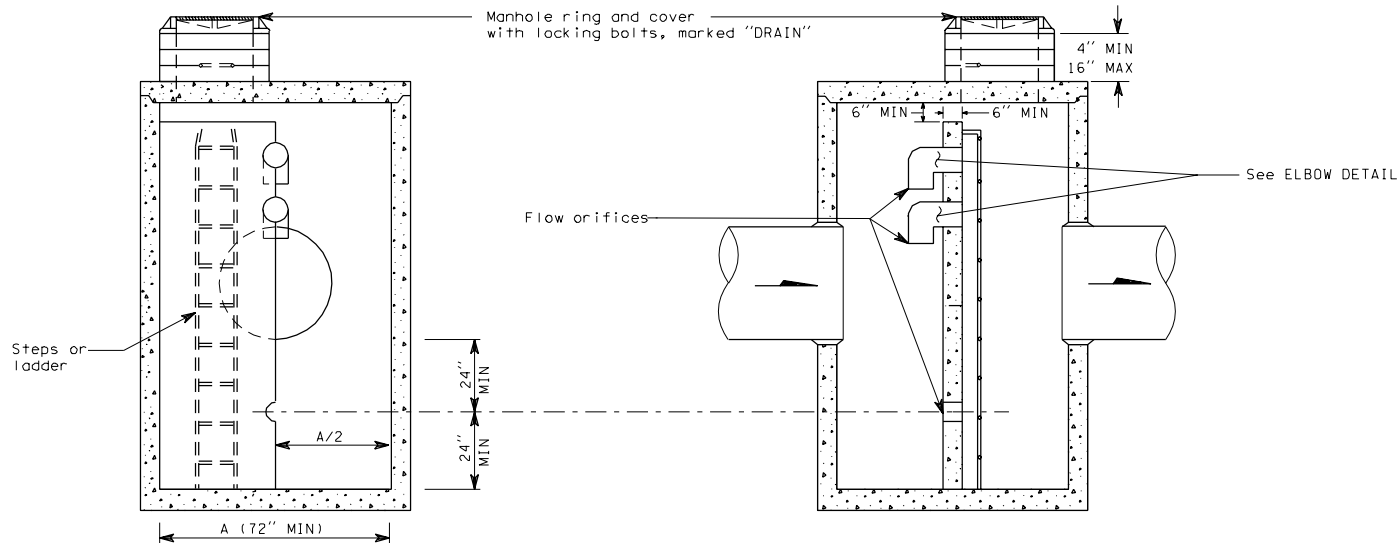

CATCH BASIN TYPE 2 WITH BAFFLE TYPE FLOW RESTRICTOR-OIL SEPARATOR

ELEVATION